
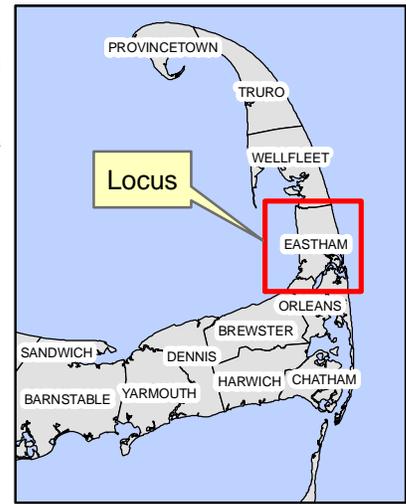


Figures

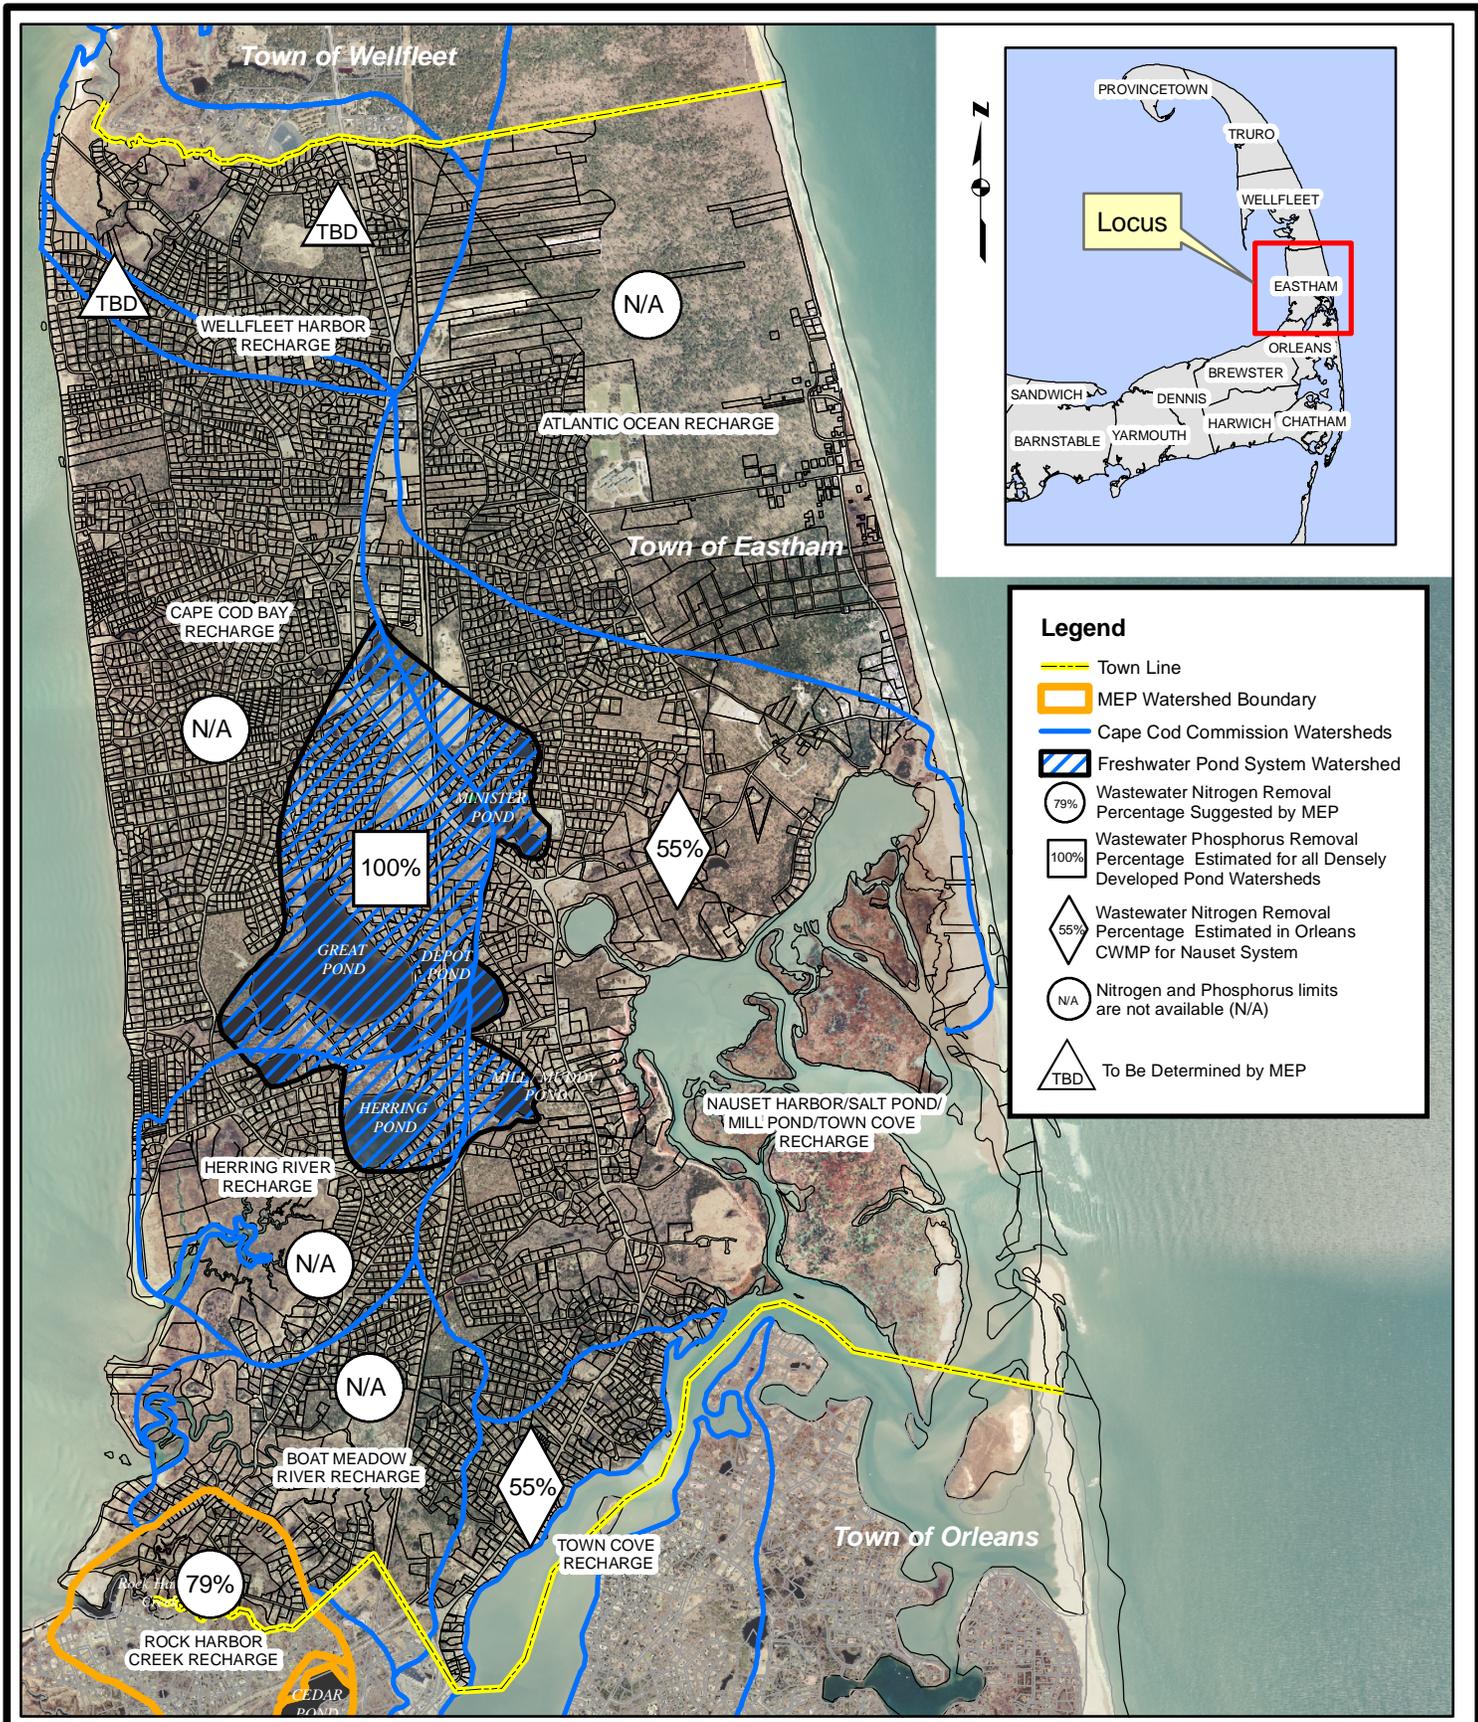

Legend

- Town Line
- MEP Watershed Boundary
- Cape Cod Commission Watersheds
- Freshwater Pond System Watershed
- 79% Wastewater Nitrogen Removal Percentage Suggested by MEP
- 100% Wastewater Phosphorus Removal Percentage Estimated for all Densely Developed Pond Watersheds
- 55% Wastewater Nitrogen Removal Percentage Estimated in Orleans CWMP for Nauset System
- N/A Nitrogen and Phosphorus limits are not available (N/A)
- TBD To Be Determined by MEP

STEARNS & WHELER^{LLC}
 Environmental Engineers & Scientists
 HYANNIS, MASSACHUSETTS

1545 Iyanough Road
 Phone: 508 362-5680
 Fax: 508 362-5684
 Web: stearnswheeler.com

TOWN OF EASTHAM, MASSACHUSETTS


WATERSHED DELINEATIONS AND ESTIMATED % NUTRIENT REMOVAL

FIGURE 1-1

Location: G:\Jobs\60000\61204 Eastham\Figures\
 Executive Summary 4_1_09\61204F1-1.mxd

Job No.: 61204

Date: 4/09

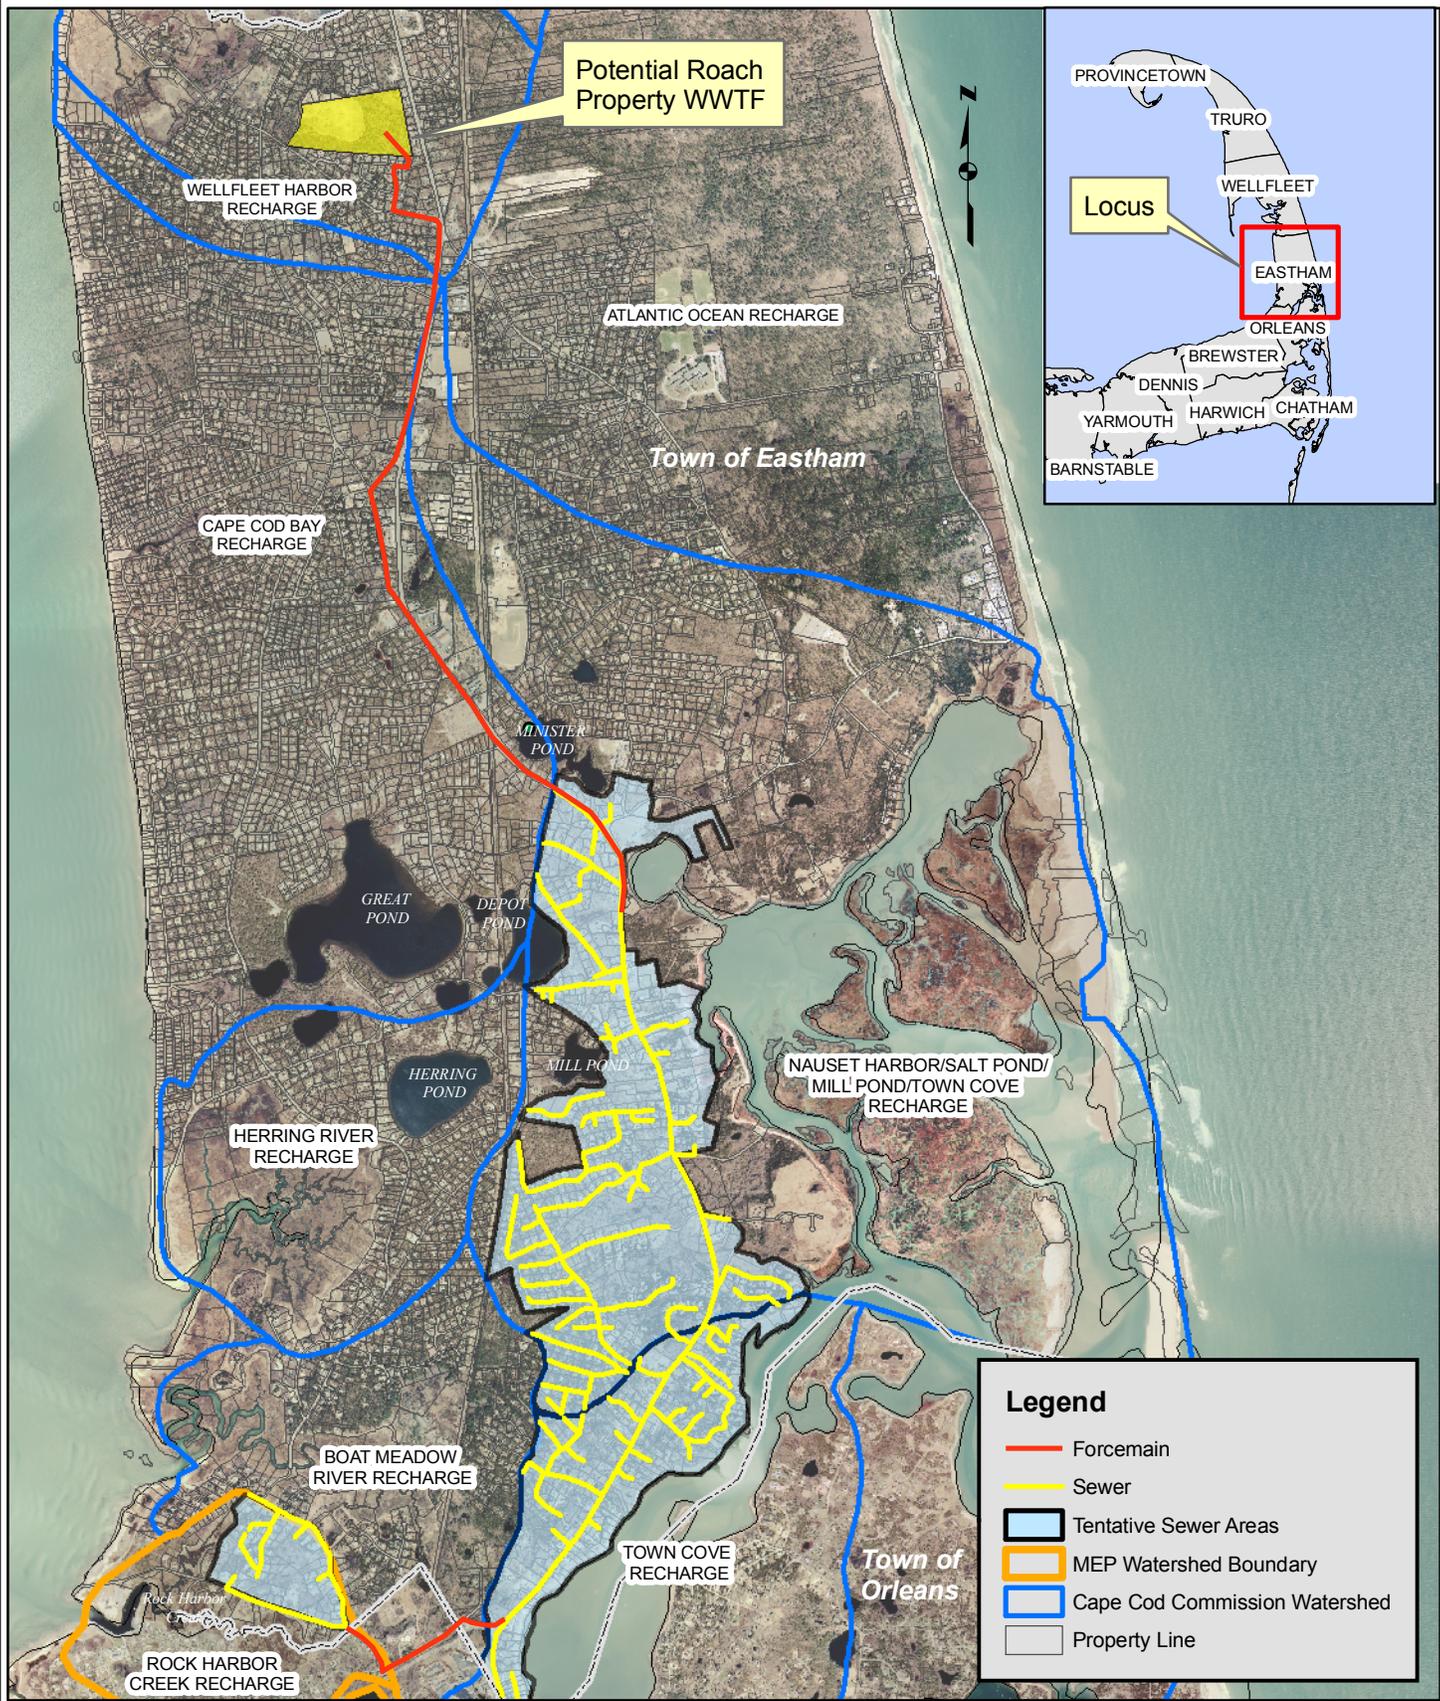


Note: Force main locations are for illustrative purposes only. Exact locations have not been determined.

STEARNS & WHELER^{LC}
 Environmental Engineers & Scientists
 HYANNIS, MASSACHUSETTS
 1545 Iyanough Road
 Phone: 508 362-5650
 Fax: 508 362-5654
 Web: stearnswheler.com

TOWN OF EASTHAM, MASSACHUSETTS

**Tentative Sewer Areas
 To Potential Roach Property WWTF**

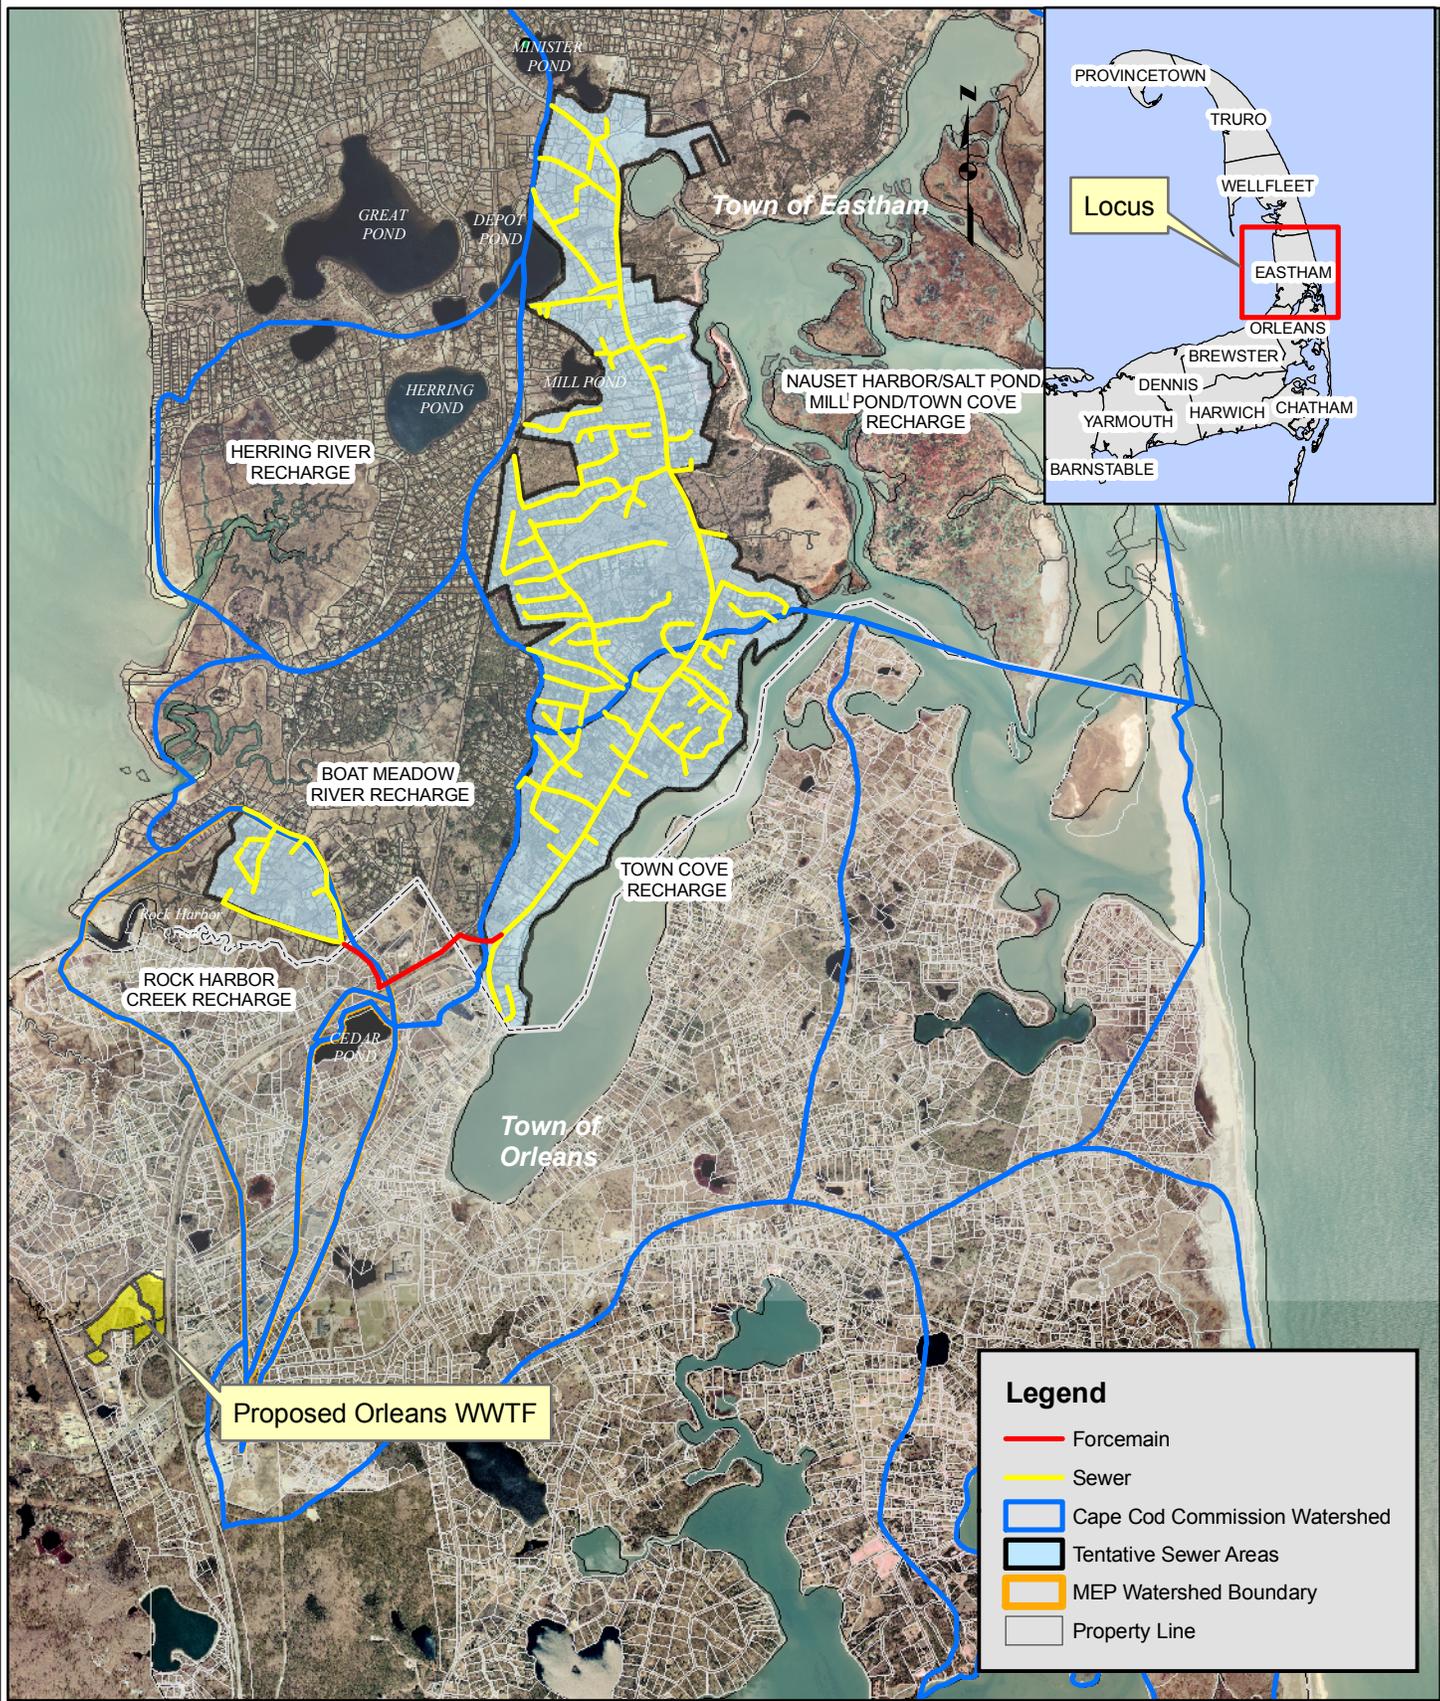

Note: Force main locations are for illustrative purposes only. Exact locations have not been determined.

STEARNS & WHELER^{LLC}
 Environmental Engineers & Scientists
 HYANNIS, MASSACHUSETTS

1545 Iyanough Road
 Phone: 508 362-5680
 Fax: 508 362-5684
 Web: stearnswheler.com

TOWN OF EASTHAM, MASSACHUSETTS

Tentative Sewer Areas To Proposed Orleans WWTF

FIGURE 2-2